

NOTES:

1. MAIN COLLECTION PIT SIZING MUST HOLD A MINIMUM OF 10MM OR DESIGNATED AMOUNT OF FIRST FLUSH CAPTURE VOLUME. IE. WASH SLAB: 100 M2 X 10MM FIRST FLUSH DEPTH = 1000 LITRE WORKING VOLUME CAPACITY.
2. THIS IS A SCHEMATIC REPRESENTATION ONLY, SITE SPECIFIC INSTALLATION MAY DIFFER.
3. LOCAL PLUMBING REGULATIONS SHOULD BE CHECKED PRIOR TO INSTALLATION.
4. PRESSURE PIPE DIAMETER MUST BE CHECKED AGAINST PUMP MANUAL FOR CORRECT PIPE DIAMETER TO ENSURE PUMP WARRANTY IS NOT VOIDED.
5. PIPE MATERIAL SHOULD BE IN ACCORDANCE WITH LOCAL PLUMBING REGULATIONS.
6. DN50 OIL SEPARATOR DRAIN LINE TO MAIN COLLECTION PIT SHOULD BE INSTALLED IF UNIT IS INSTALLED OUTSIDE OF WASH PAD BUND.
7. COLLECTION PIT MINIMUM CAPACITY MAY APPLY DEPENDING ON INSTALLATION LOCATION.
8. WASH LINES TO HAVE AN APPROVED RPZ DEVICE INSTALLED IN ACCORDANCE WITH LOCAL PLUMBING REGULATIONS.
9. QUICK BREAK DETERGENTS MUST BE USED AT ALL TIMES, USE OF SOLVENT BASED DETERGENTS MAY EFFECT EFFICIENCY OF THE UNIT.
10. ALL ELECTRICAL CONNECTIONS ARE TO COMPLY WITH LOCAL REGULATIONS.

CleanaWater[®]


TITLE: UNROOFED WASH BAY
FIRST FLUSH SYSTEM &
TRADE WASTE TREATMENT

DWG NO. AA - 336RG
SHEET 1 OF 1 SCALE: 1:1/2 A3 DO NOT SCALE DRAWING

UNLESS OTHERWISE SPECIFIED:
DIMENSIONS ARE IN MILLIMETERS
SURFACE FINISH:
TOLERANCES:
LINEAR:
ANGULAR:
MATERIAL: VARIOUS
WEIGHT: N/A

NAME	SIGNATURE	DATE	REVISION
DRAWN			FINISH:
CHK'D			

PROPRIETARY AND CONFIDENTIAL
THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF CLEANAWATER. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF CLEANAWATER IS PROHIBITED.
CLEANAWATER, 4 CHANNEL RD, MAYFIELD WEST NSW 2304. 1800 353 788

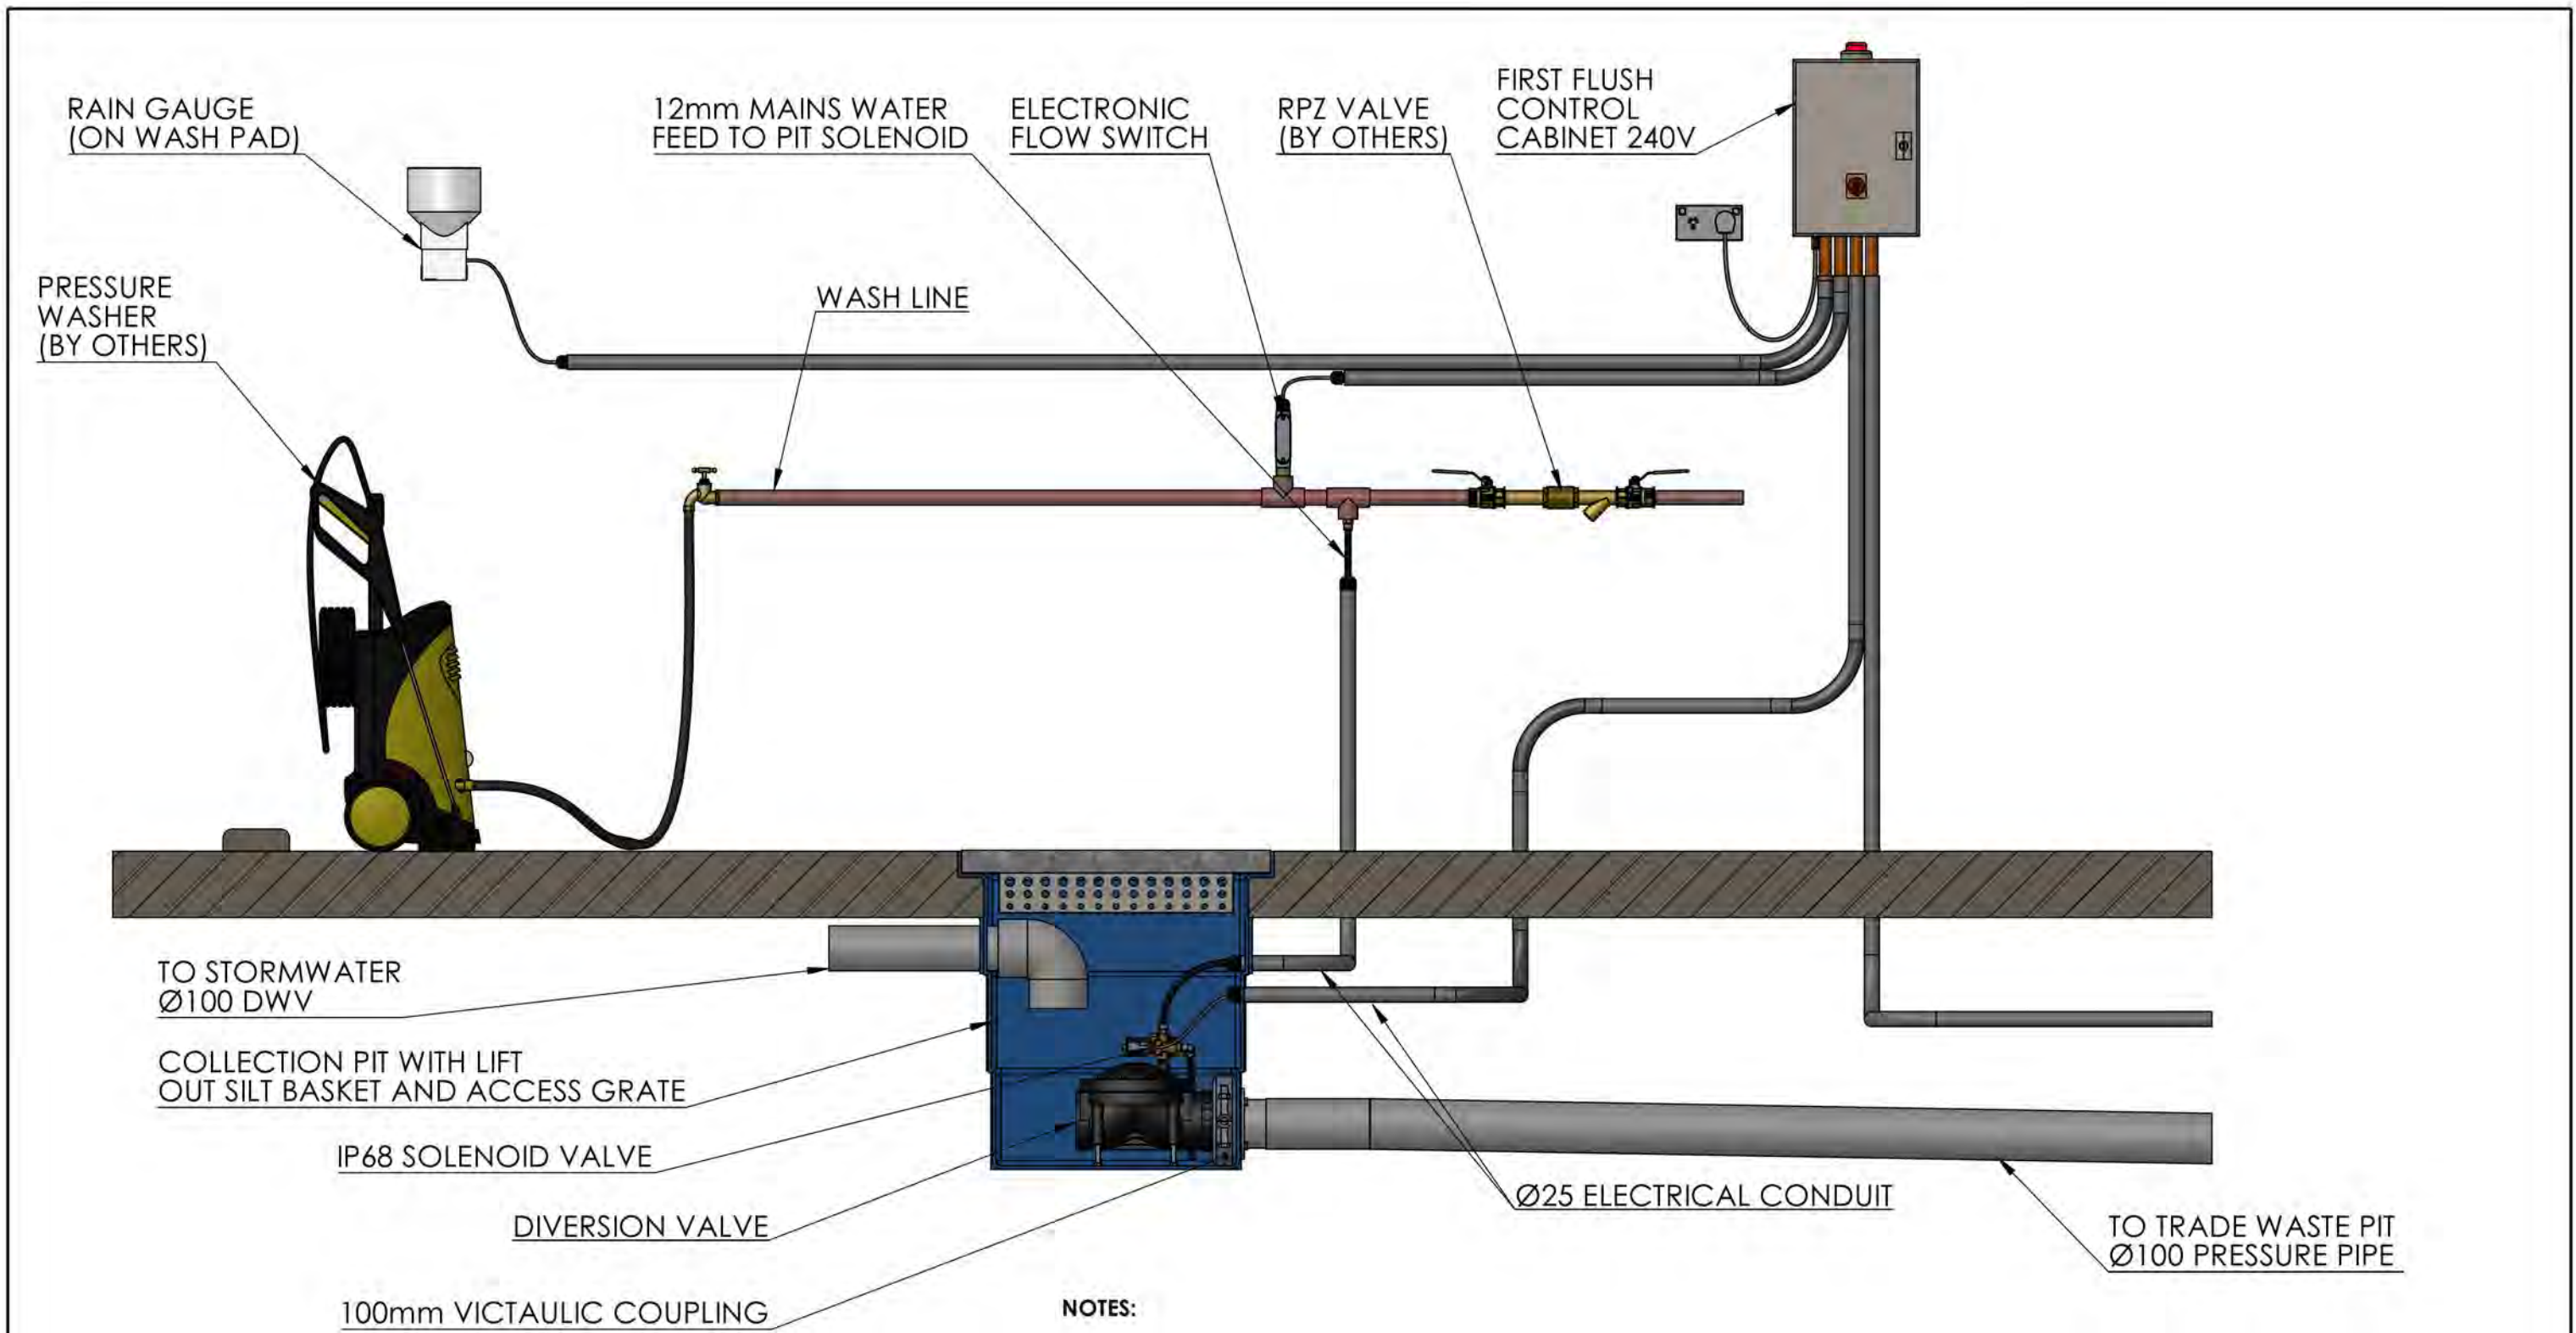

NOTES:

1. MAIN COLLECTION PIT SIZING MUST HOLD A MINIMUM OF 10MM OR DESIGNATED AMOUNT OF FIRST FLUSH CAPTURE VOLUME. IE. WASH SLAB: 100 M2 X 10MM FIRST FLUSH DEPTH = 1000 LITRE WORKING VOLUME CAPACITY.
2. THIS IS A SCHEMATIC REPRESENTATION ONLY, SITE SPECIFIC INSTALLATION MAY DIFFER.
3. LOCAL PLUMBING REGULATIONS SHOULD BE CHECKED PRIOR TO INSTALLATION.
4. PRESSURE PIPE DIAMETER MUST BE CHECKED AGAINST PUMP MANUAL FOR CORRECT PIPE DIAMETER TO ENSURE PUMP WARRANTY IS NOT VOIDED.
5. PIPE MATERIAL SHOULD BE IN ACCORDANCE WITH LOCAL PLUMBING REGULATIONS.
6. DN50 OIL SEPARATOR DRAIN LINE TO MAIN COLLECTION PIT SHOULD BE INSTALLED IF UNIT IS INSTALLED OUTSIDE OF WASH PAD BUND.
7. COLLECTION PIT MINIMUM CAPACITY MAY APPLY DEPENDING ON INSTALLATION LOCATION.
8. WASH LINES TO HAVE AN APPROVED RPZ DEVICE INSTALLED IN ACCORDANCE WITH LOCAL PLUMBING REGULATIONS.
9. QUICK BREAK DETERGENTS MUST BE USED AT ALL TIMES, USE OF SOLVENT BASED DETERGENTS MAY EFFECT EFFICIENCY OF THE UNIT.
10. ALL ELECTRICAL CONNECTIONS ARE TO COMPLY WITH LOCAL REGULATIONS.

CleanaWater®

TITLE: UNROOFED WASH BAY FIRST FLUSH SYSTEM		DWG NO. AA - 337RG		UNLESS OTHERWISE SPECIFIED: DIMENSIONS ARE IN MILLIMETERS SURFACE FINISH: TOLERANCES: LINEAR: ANGULAR:		MATERIAL: VARIOUS		NAME		SIGNATURE		DATE		REVISION	
SHEET 1 OF 1		SCALE: n/a		A3		DO NOT SCALE DRAWING		DRAWN						FINISH:	
						WEIGHT: N/A		CHK'D						DEBUR AND BREAK SHARP EDGES	

PROPRIETARY AND CONFIDENTIAL
THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF CLEANAWATER. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF CLEANAWATER IS PROHIBITED.
CLEANAWATER, 4 CHANNEL RD, MAYFIELD WEST NSW 2304. 1800 353 788